



120V., 20 Amp Feed
From Disconnect

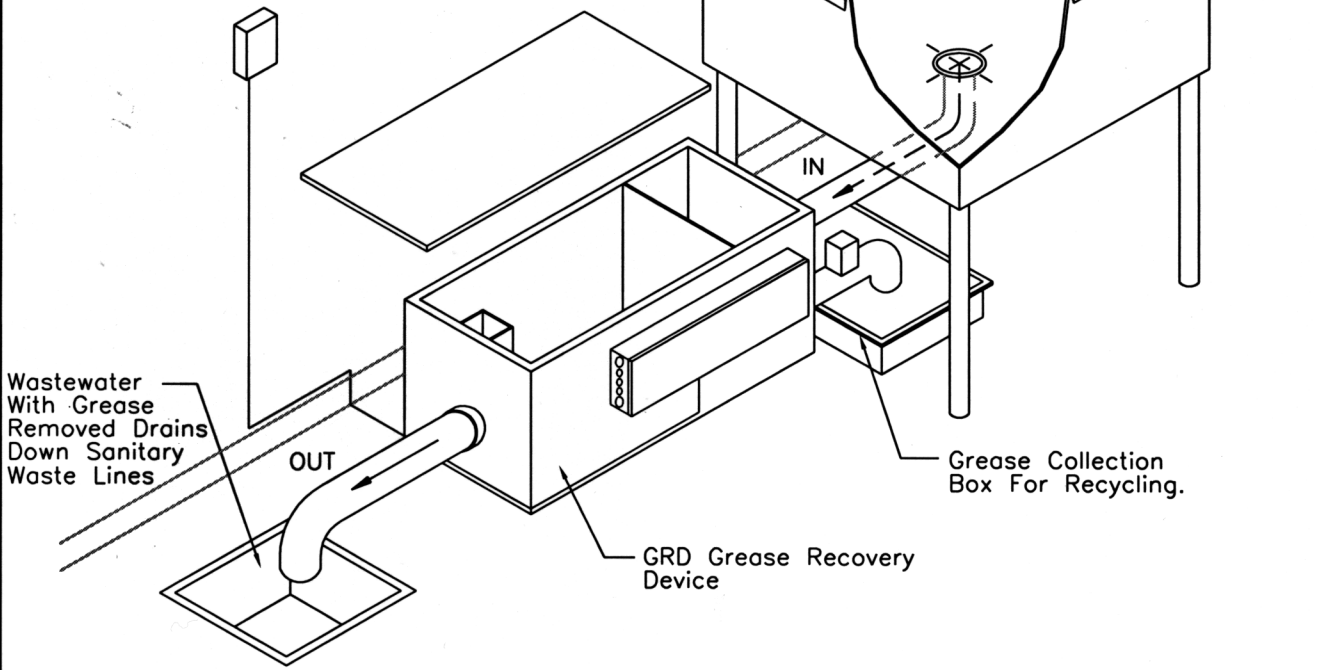

Notes:

1. The Sink Or Fixture Must Be Installed With Indirect Drain Lines To Meet The Local Codes.
2. For 2 Or More Sinks, Reduce Each Drain To A Maximum Of 1" To Control The flow To The Grease Recovery Device.
3. Acceptable Units Are International GRD Model 25001B, Highland Tank Model AGI 25, Or Equal.
4. Systems To Comply With International Plumbing Code Section 1003.

APPROVAL	REVISED	TOWN OF EASTON AND EASTON UTILITIES COMMISSION STANDARD DETAILS GREASE RECOVERY DEVICE
 12/1/08 EU MANAGER OF ENGINEERING DATE		
ISSUED: DEC 1, 2008		STANDARD NO. SS-9.40