
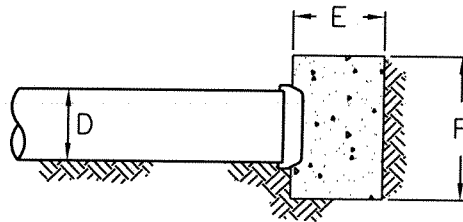


BUTTRESS FOR HORIZONTAL BENDS

BUTTRESS FOR HORIZONTAL BENDS						
BEND	6"	8"	10"	12"	16"	
1/32	A	6"	8"	10"	1'-0"	1'-4"
	B	7"	8"	9"	10"	1'-0"
	C	7"	7"	8"	8"	9"
1/16	A	9"	1'-0"	1'-6"	1'-9"	2'-3"
	B	7"	8"	9"	10"	1'-0"
	C	8"	9"	10"	11"	1'-2"
1/8	A	1'-3"	1'-8"	2'-1"	2'-6"	3'-4"
	B	7"	8"	9"	11"	1'-3"
	C	8"	9"	10"	11"	1'-2"
1/4	A	2'-0"	2'-6"	3'-0"	3'-6"	5'-0"
	B	6"	9"	1'-0"	1'-3"	1'-6"
	C	1'-10"	1'-9"	1'-8"	1'-7"	1'-5"

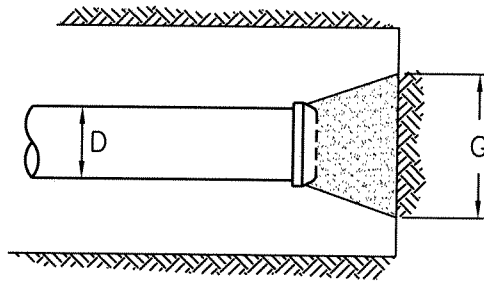

Carry Concrete To Solid Ground

SECTION

BUTTRESS FOR CAPS AND PLUGS					
D	6"	8"	10"	12"	16"
E	6"	8"	8"	10"	1'-0"
F	1'-0"	1'-4"	1'-6"	2'-0"	2'-8"
G	1'-5"	1'-11"	2'-5"	2'-10"	3'-9"

Notes:

1. All Concrete Shall Be SHA Mix No. 1.
2. Buttress Dimensions Are Minimum. Dimensions Are Based Upon Soil Bearing Pressure Of 3000 P.S.F. And Static Water Pressure Of 150 P.S.I. Where Pressure Exceeds 150 P.S.I. Or Where Soil Bearing Pressure Is Less Than 3000 P.S.F. Special Buttress Design Is Required.

BUTTRESS FOR CAPS AND PLUGS

APPROVAL	REVISED	TOWN OF EASTON AND EASTON UTILITIES STANDARD DETAILS BUTTRESSES FOR CAPS AND HORIZONTAL BENDS
<i>Talbot W Bone</i> 4/25/06 EU MANAGER OF ENGINEERING DATE		
ISSUED: MAY 1, 1986		STANDARD NO. W-3.00